


1" - 21" D & L 2244 CAST IRON METER BOX RING  
 3/4" - 18" CAST IRON METER BOX RING  
 TYLER 6150 - 18, OR  
 D & L L-2240, OR EQUAL  
 ALL WITH POLY AMR LID DFWO-12 OR EQUAL

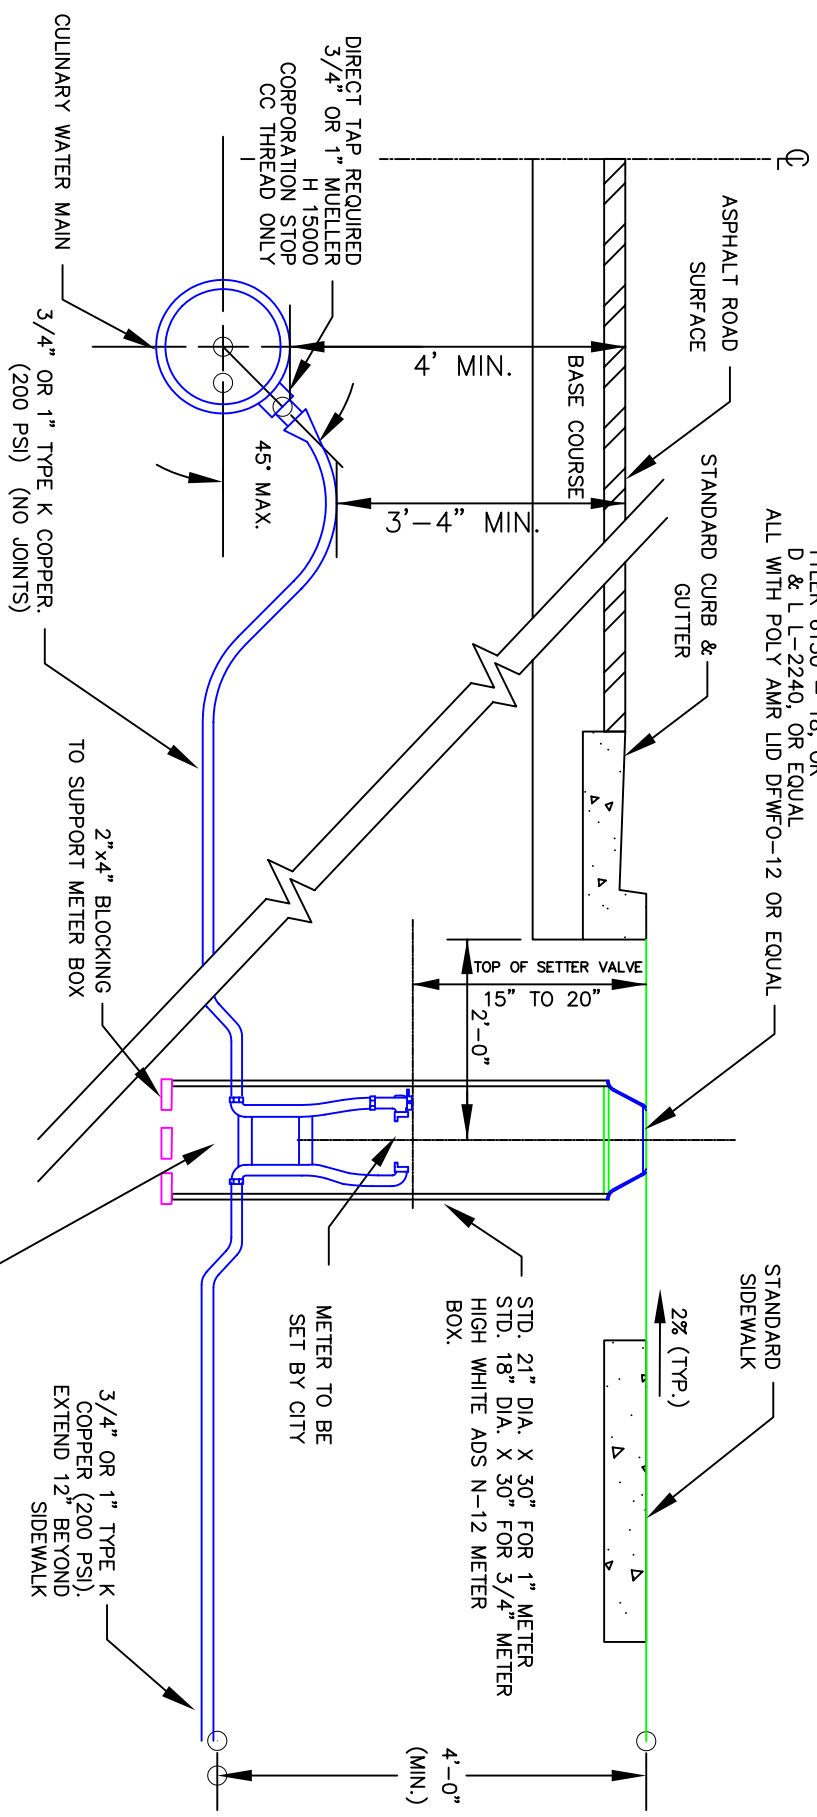

- NOTES:
1. 10'-0" EDGE TO EDGE HORIZONTAL CLEARANCE IS REQUIRED BETWEEN WATER AND SEWER LATERAL SERVICE.
  2. WHERE WATER AND SEWER LATERALS MUST CROSS, WATER LATERAL SHALL BE 18" ABOVE THE SEWER LATERAL AS MEASURED FROM THE BOTTOM OF THE WATER LATERAL TO THE TOP OF THE SEWER LATERAL. THIS SEPARATION SHALL BE MAINTAINED FOR AT LEAST 10'-0" EITHER SIDE OF CROSS POINT.

METER SETTER  
 3/4" x 7 1/2" (WITH TIE BAR)  
 FORD VB 73-18W-11-33-7.5, OR  
 MUELLER 240-B-2434-26  
 1" (WITH TIE BAR)  
 FORD VB 74-18WT-11-44, OR  
 MUELLER B2434-01018

1	RSS	UPDATE	12/21/99
2		REVIEWED	2004
3	DKW	UPDATE	5/24/06
NO.	AUTHORIZED BY	REVISIONS	DATE



STANDARD DETAIL  
 FIGURE\_1  
 3/4" AND 1" WATER SERVICE

SCALE: SCALE